



Specification For Approval

Customer Name : _____

RHT P/N: RHTDYST-002

Description : _____

Date 2026-7-23

Approved by
Sign : date :
Please return by one copy

Design: Pan Checked: Andy Approved: Feng

Address:Maoshan Industrial Park, Huajiafen Village, Jiangshan Town,

Yinzhou District Ningbo City, Zhejiang,POSTAL:315193

Tel:086-574-56176016 M:0086-15168501684

E-mail:info@rhtecp.com Web:www.rhtecp.com www.rhtconn.com



Fuses * Fuse Holders*Battery Holders

Overload Switches

Manual Reset Circuit Breaker

Specification:



1.Rating current: min.5A, max.16A 2.Working pressure: min.12V, max.250V 3.Double usage of DC and AC

4.Current specification: 5-16A TUV

Application scope:

Used at the protection of compound outlet, power transformer and electrical motor.

Dimension for outline:

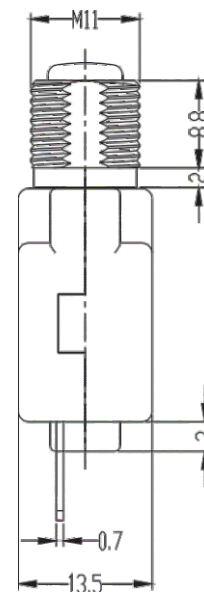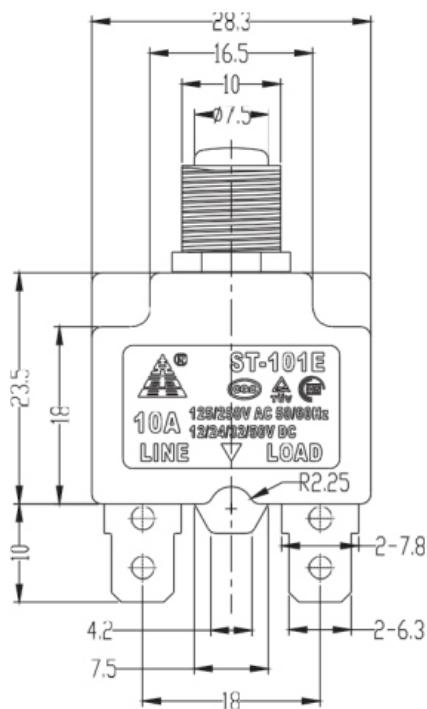



Overload Switches

Manual Reset Circuit Breaker

Specification:


- 1.Rating current: min.5A, max.16A
- 2.Working pressure: min.12V, max.250V
- 3.Double usage of DC and AC
- 4.Current specification: 5-16A TUV

Application scope:

Used at the protection of compound outlet, power transformer and electrical motor.

Technique characteristic:the test temperature(20°-25°), the reference curve as followed:

Short circuit test, the ambient temperature:25°

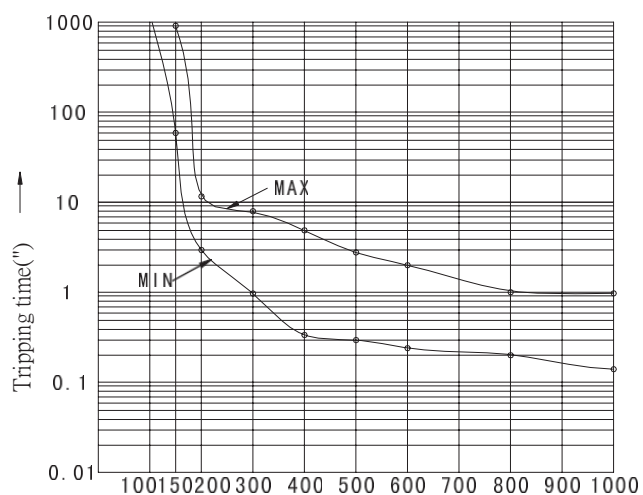

current overload rating current PCT	Tripping time
105 %	1 hour no tripping
150 %	1 hour tripping
200 %	3.0-18 "
300 %	0.8-8 "
400 %	0.35-5 "
500 %	0.3-2.8 "
600 %	0.25-2 "
800 %	0.2-1 "
1000 %	0.15-0.8 "